

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

SPONSOR: **Moxie Surfaces**
Encinitas, CA

Sound Absorption
RAL™-A24-154

CONDUCTED: 2024-03-20

Page 1 of 10

ON: AIR-board Acoustic – 3/4” – (Type F-100 Mounting)

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as AIR-board Acoustic – 3/4”. The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: AIR-board Acoustic – 3/4”
Manufacturer: Design Composite
US Distributor: Moxie Surfaces

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Material: Panels, honeycomb core and microperforated sheets on face and back
Dimensions: 2 panels @ 1219 mm (48 in.) by 2438 mm (96 in.)
Thickness: 19.2 mm (0.756 in.)
Overall Weight: 20.41 kg (45 lbs)

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 2 of 10

Overall Specimen Properties

Size: 2.44 m (96.0 in) wide by 2.44 m (96.0 in) long
Thickness: 0.02 m (0.756 in)
Weight: 20.41 kg (45.0 lbs)
Mass per Unit Area: 3.43 kg/m² (0.7 lbs/ft²)
Calculation Area: 5.946 m² (64. ft²)

Test Environment

Room Volume: 291.98 m³
Temperature: 21.4 °C ± 0.0 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)
Relative Humidity: 62.05 % ± 1.3 % (Requirement: ≥ 40 % and ≤ 5 % change)
Barometric Pressure: 99.0 kPa (Requirement not defined)

MOUNTING METHOD

Type F-100 Mounting: The test specimen was laid over wood spacers placed on the horizontal test surface, creating a 102 mm (4 in.) thick airspace between the test surface and the panel body. The numeral suffix in the mounting designation is the thickness of the spacers in millimeters, rounded to the nearest integer multiple of 5. Perimeter edges were sealed with wood and metal framing and tape.

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154

Page 3 of 10

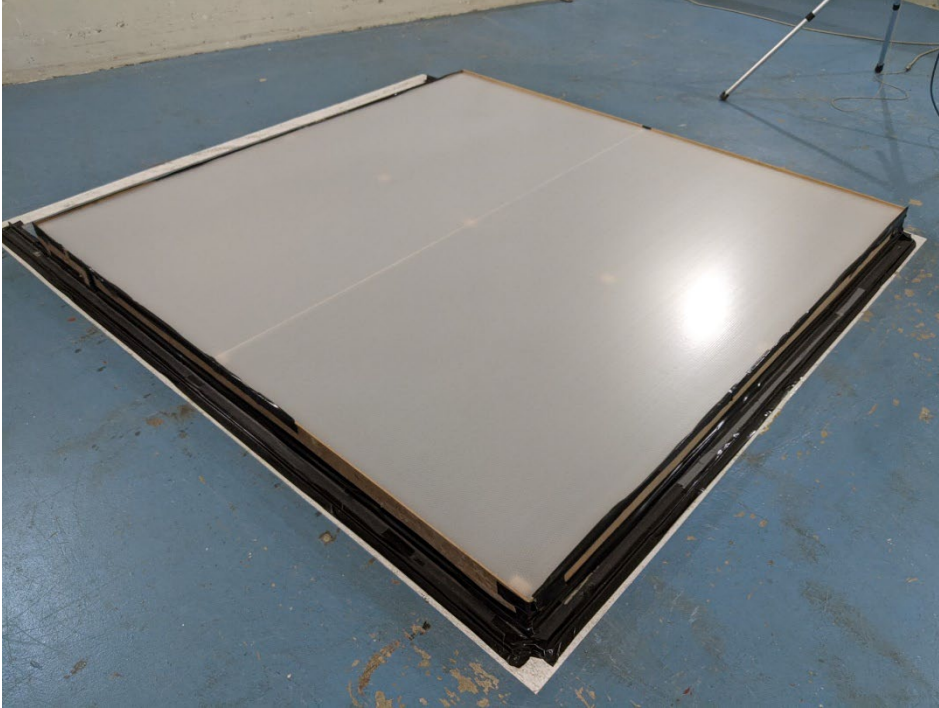


Figure 1 – Specimen mounted in test chamber



Figure 2 – Individual specimen panel

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 4 of 10



Figure 3 – Wood spacers in test chamber



Figure 4 – Specimen partially installed over spacers

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 5 of 10



Figure 5 – Detail of specimen materials

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 6 of 10

TEST RESULTS

Specimen total absorption and absorption coefficient are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages.

1/3 Octave Center Frequency (Hz)	Total Absorption (m ²)	Total Absorption (Sabins)	Absorption Coefficient
100	1.03	11.08	0.17
** 125	0.92	9.89	0.15
160	0.86	9.28	0.14
200	1.29	13.94	0.22
** 250	1.73	18.63	0.29
315	2.46	26.53	0.41
400	3.07	33.01	0.52
** 500	3.79	40.77	0.64
630	4.23	45.52	0.71
800	3.85	41.49	0.65
** 1000	3.56	38.36	0.60
1250	3.11	33.53	0.52
1600	2.92	31.40	0.49
** 2000	3.99	42.94	0.67
2500	4.57	49.21	0.77
3150	4.85	52.21	0.82
** 4000	4.29	46.19	0.72
5000	3.41	36.69	0.57

SAA = 0.54
NRC = 0.55

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 7 of 10


TEST RESULTS (continued)

The sound absorption average (SAA) is defined in ASTM C423-23 Section 3.1.1 as the arithmetic average of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 Hz through 2500 Hz, inclusive, rounded to the nearest integer multiple of 0.01.

The noise reduction coefficient (NRC) is defined from previous versions of ASTM C423 as the arithmetic average of the sound absorption coefficients at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, rounded to the nearest integer multiple of 0.05.

Tested by 
Marc Sciaky
Senior Experimentalist

Report by 
Keith Kimberling
Test Engineer

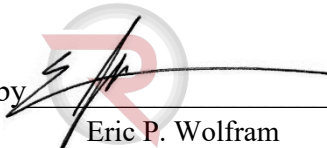Approved by 
Eric P. Wolfram
Laboratory Manager

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report


www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 8 of 10

SOUND ABSORPTION REPORT
AIR-board Acoustic – 3/4"

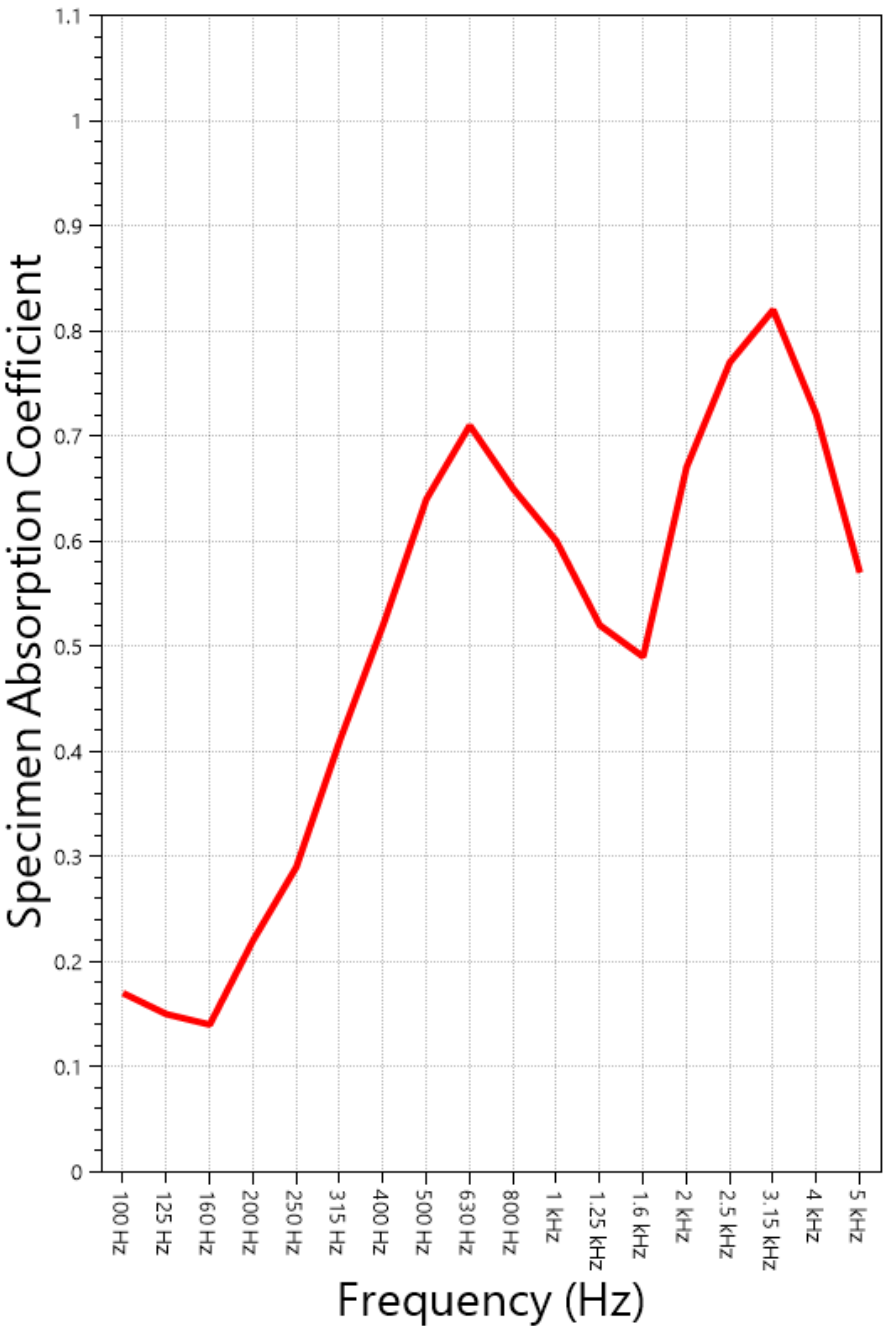

SAA = 0.54
NRC = 0.55

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 9 of 10

APPENDIX A: Extended Frequency Range Data

Specimen: AIR-board Acoustic – 3/4” (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient
31.5	1.44	0.02
40	1.05	0.02
50	-3.16	-0.05
63	-1.07	-0.02
80	5.43	0.08
100	11.08	0.17
125	9.89	0.15
160	9.28	0.14
200	13.94	0.22
250	18.63	0.29
315	26.53	0.41
400	33.01	0.52
500	40.77	0.64
630	45.52	0.71
800	41.49	0.65
1000	38.36	0.60
1250	33.53	0.52
1600	31.40	0.49
2000	42.94	0.67
2500	49.21	0.77
3150	52.21	0.82
4000	46.19	0.72
5000	36.69	0.57
6300	32.12	0.50
8000	26.11	0.41
10000	27.60	0.43
12500	54.85	0.86

627 RIVERBANK DRIVE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Moxie Surfaces
2024-03-20

RAL™-A24-154
Page 10 of 10

APPENDIX B: Instruments of Traceability

Specimen: AIR-board Acoustic – 3/4” (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160-106968	2023-07-17	2024-07-17
Bruel & Kjaer Mic And Preamp G	Type 4943-B-001	2525858	2023-05-03	2024-05-03
Bruel & Kjaer Pistonphone	Type 4228	2781248	2023-07-12	2024-07-12
EXTECH Hygro 6015	SD700	A.116015	2023-05-31	2024-05-31

APPENDIX C: Revisions to Original Test Report

Specimen: AIR-board Acoustic – 3/4” (See Full Report)

<u>Date</u>	<u>Revision</u>
2024-04-08	Original report issued

END